

PROJECT QUESTIONNAIRE

ROMOLD - pressure pipe end chamber DN 1000
acc. to ATV-A 157

Romold GmbH
Sägewerkstraße 5
D-83416 Surheim
Tel: +49-8654-4768-0
Fax: +49-8654-4768-47
E-mail: verkauf@romold.de



edited: 10/2017

order request for information

project: _____


manhole no.: _____

depth H [m]: _____
surface to channel

ground water level [m]: _____
ground water depth relative to surface

commercial cover
class: B125 D400
please indicate

seal to cone: yes no
please indicate

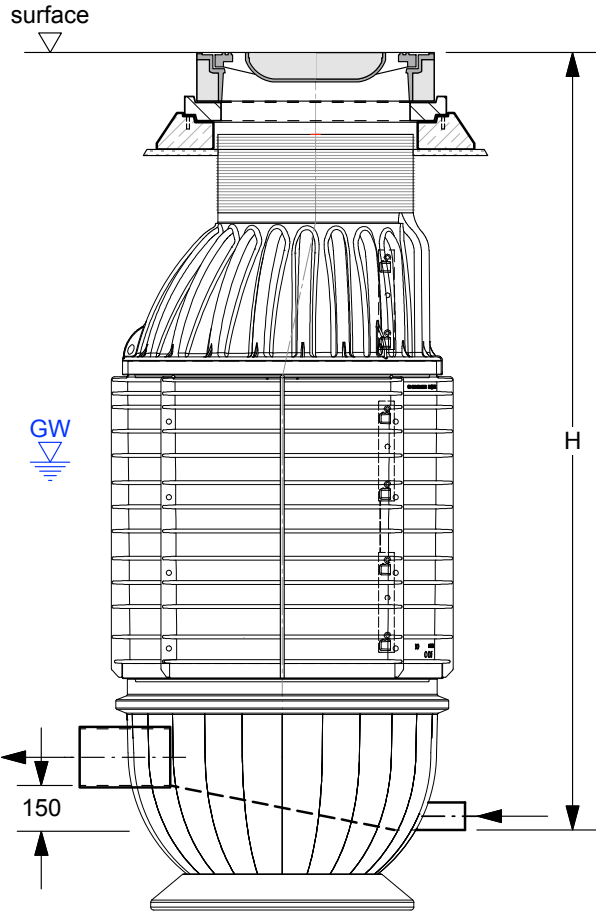

	PE-pipe Dia mm x mm	plain pipe (PVC, PP)	others, clay pipe, concrete	pipeline gradient [%]	bed drop	note
inlet pressure pipe *)					----	
outlet**)					+ 15 cm	

*) pipe connection inlet: max. OD 180
**) pipe connection outlet: max. OD 250
(larger pipe diameters on request)

company: _____

contact person: _____

tel. / fax: _____

E-mail: _____

stamp

date, signature